
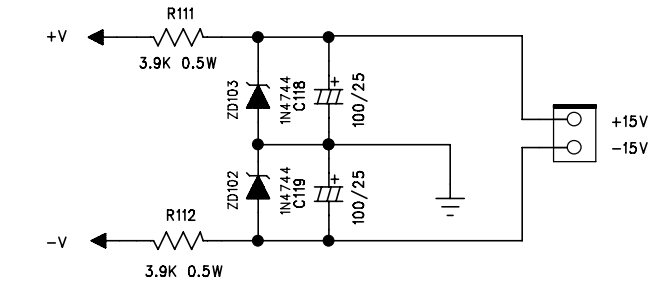
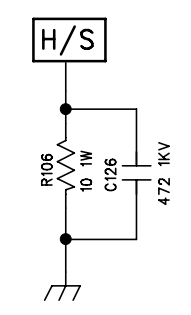
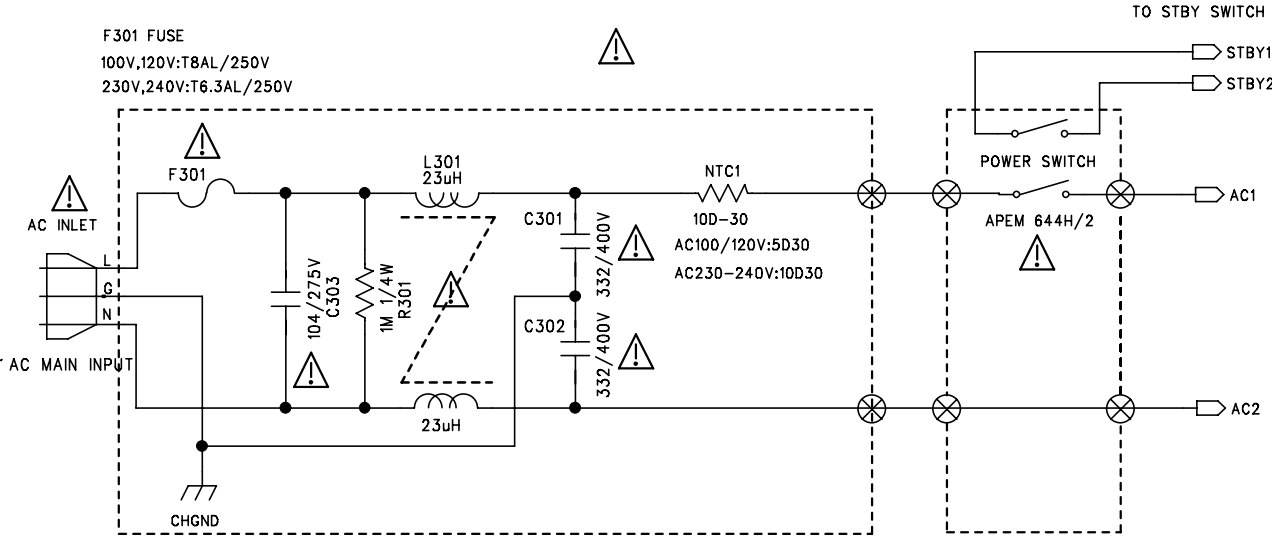


DRAWN: JS.KIM		DATED: 2009.10.05		COMPANY:			
CHECKED:		DATED:		TITLE: <b>TERROR BASS INPUT</b>			
QUALITY CONTROL:		DATED:		CODE:	SIZE:	DRAWING NO:	REV:
RELEASED:		DATED:		SCALE:		SHEET: OF	






AC100: TB500(100V)

AC115,120,230,240V: TB500(115V/230V)

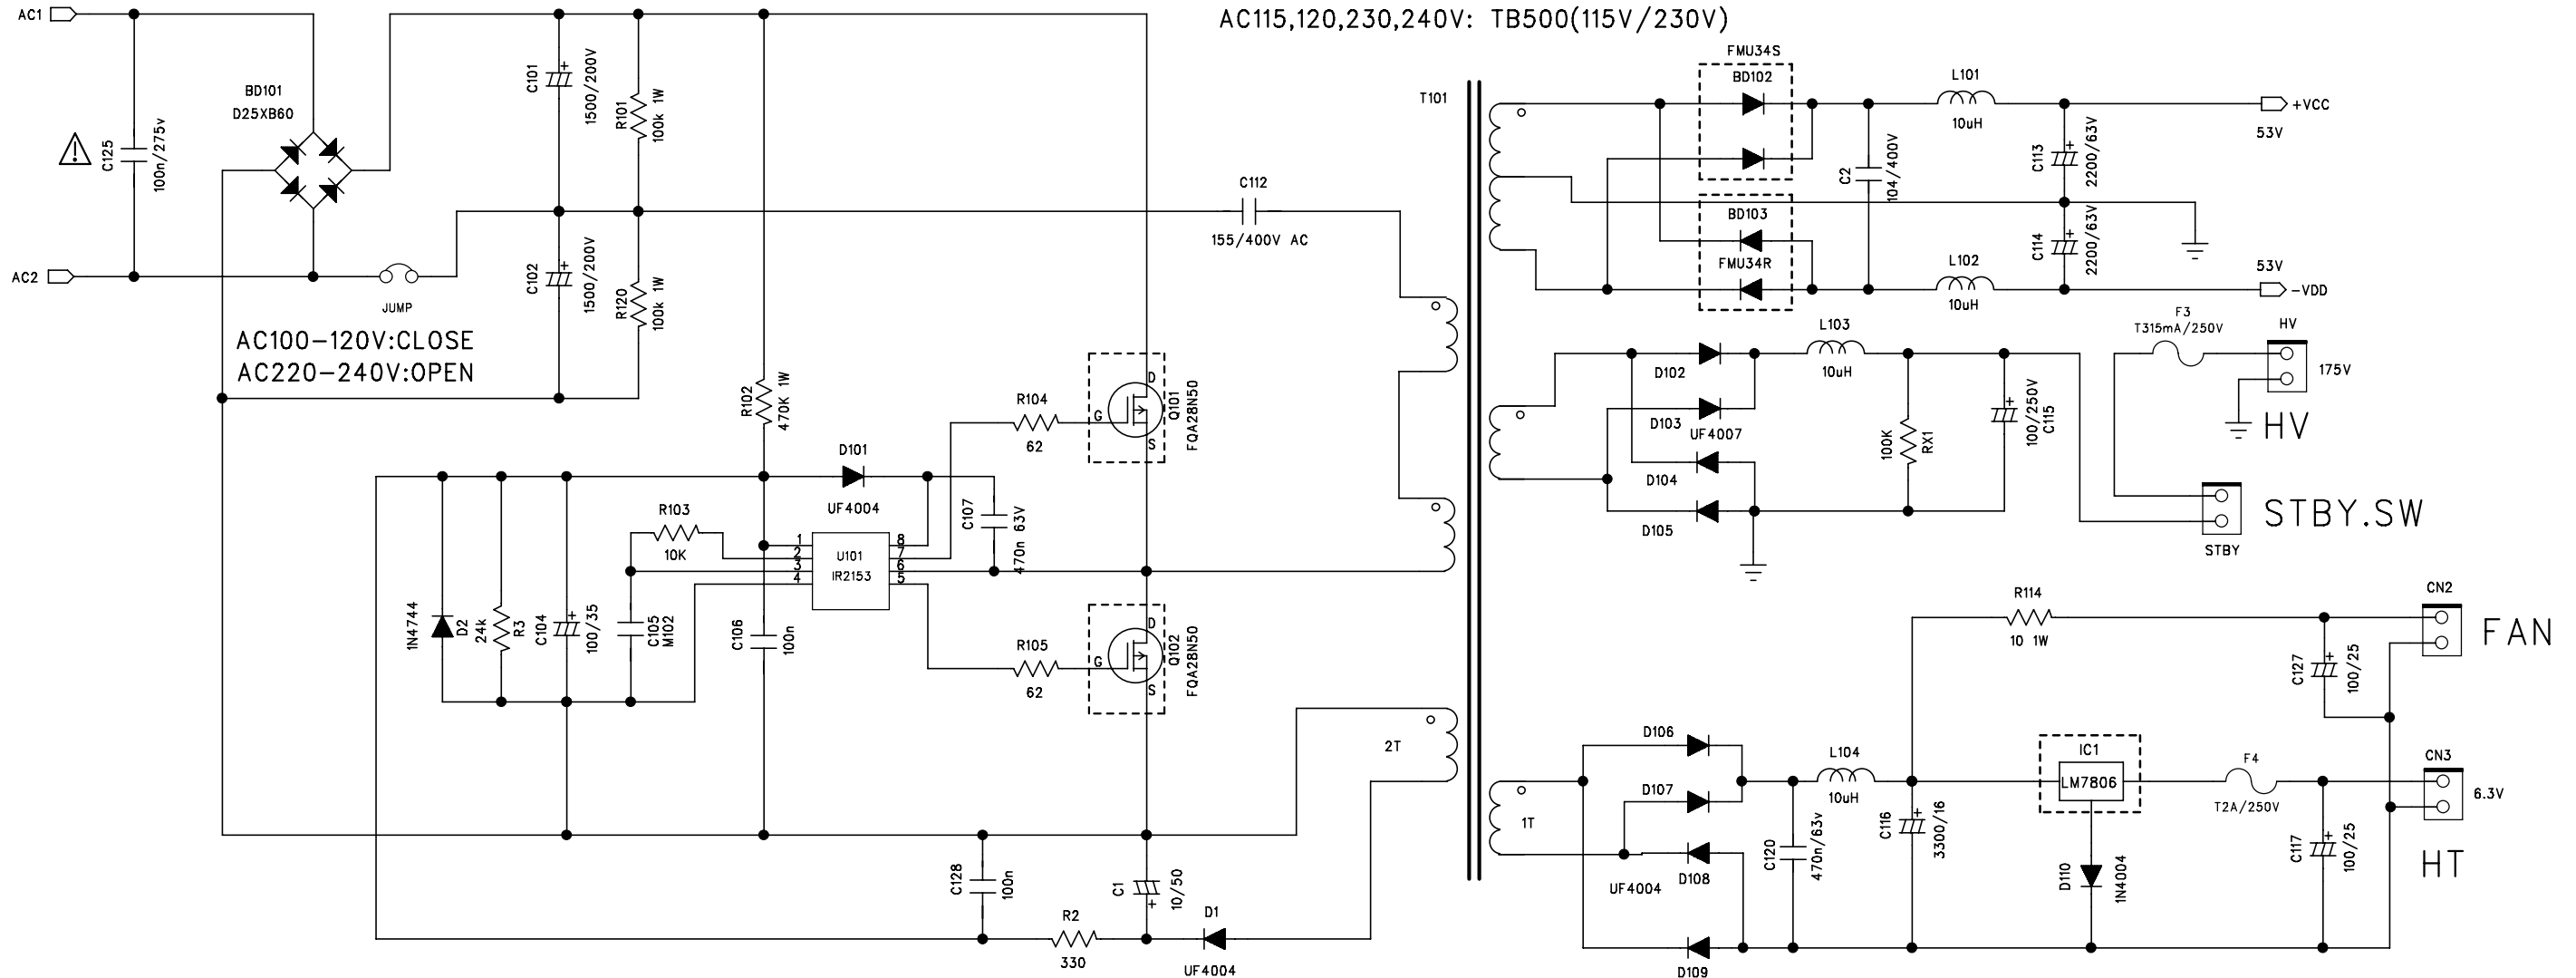

COMPANY:			
TITLE:			
<b>TERROR BASS 500W PSU</b>			
CODE:	SIZE:	DRAWING NO:	REV:
SCALE:		SHEET: OF	

DRAWN:	DATED:
J.S.KIM	2009.08.21
CHECKED:	DATED:
QUALITY CONTROL:	DATED:
RELEASED:	DATED:

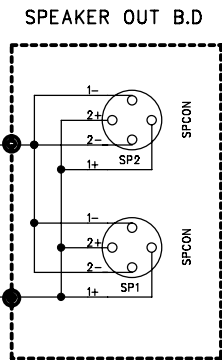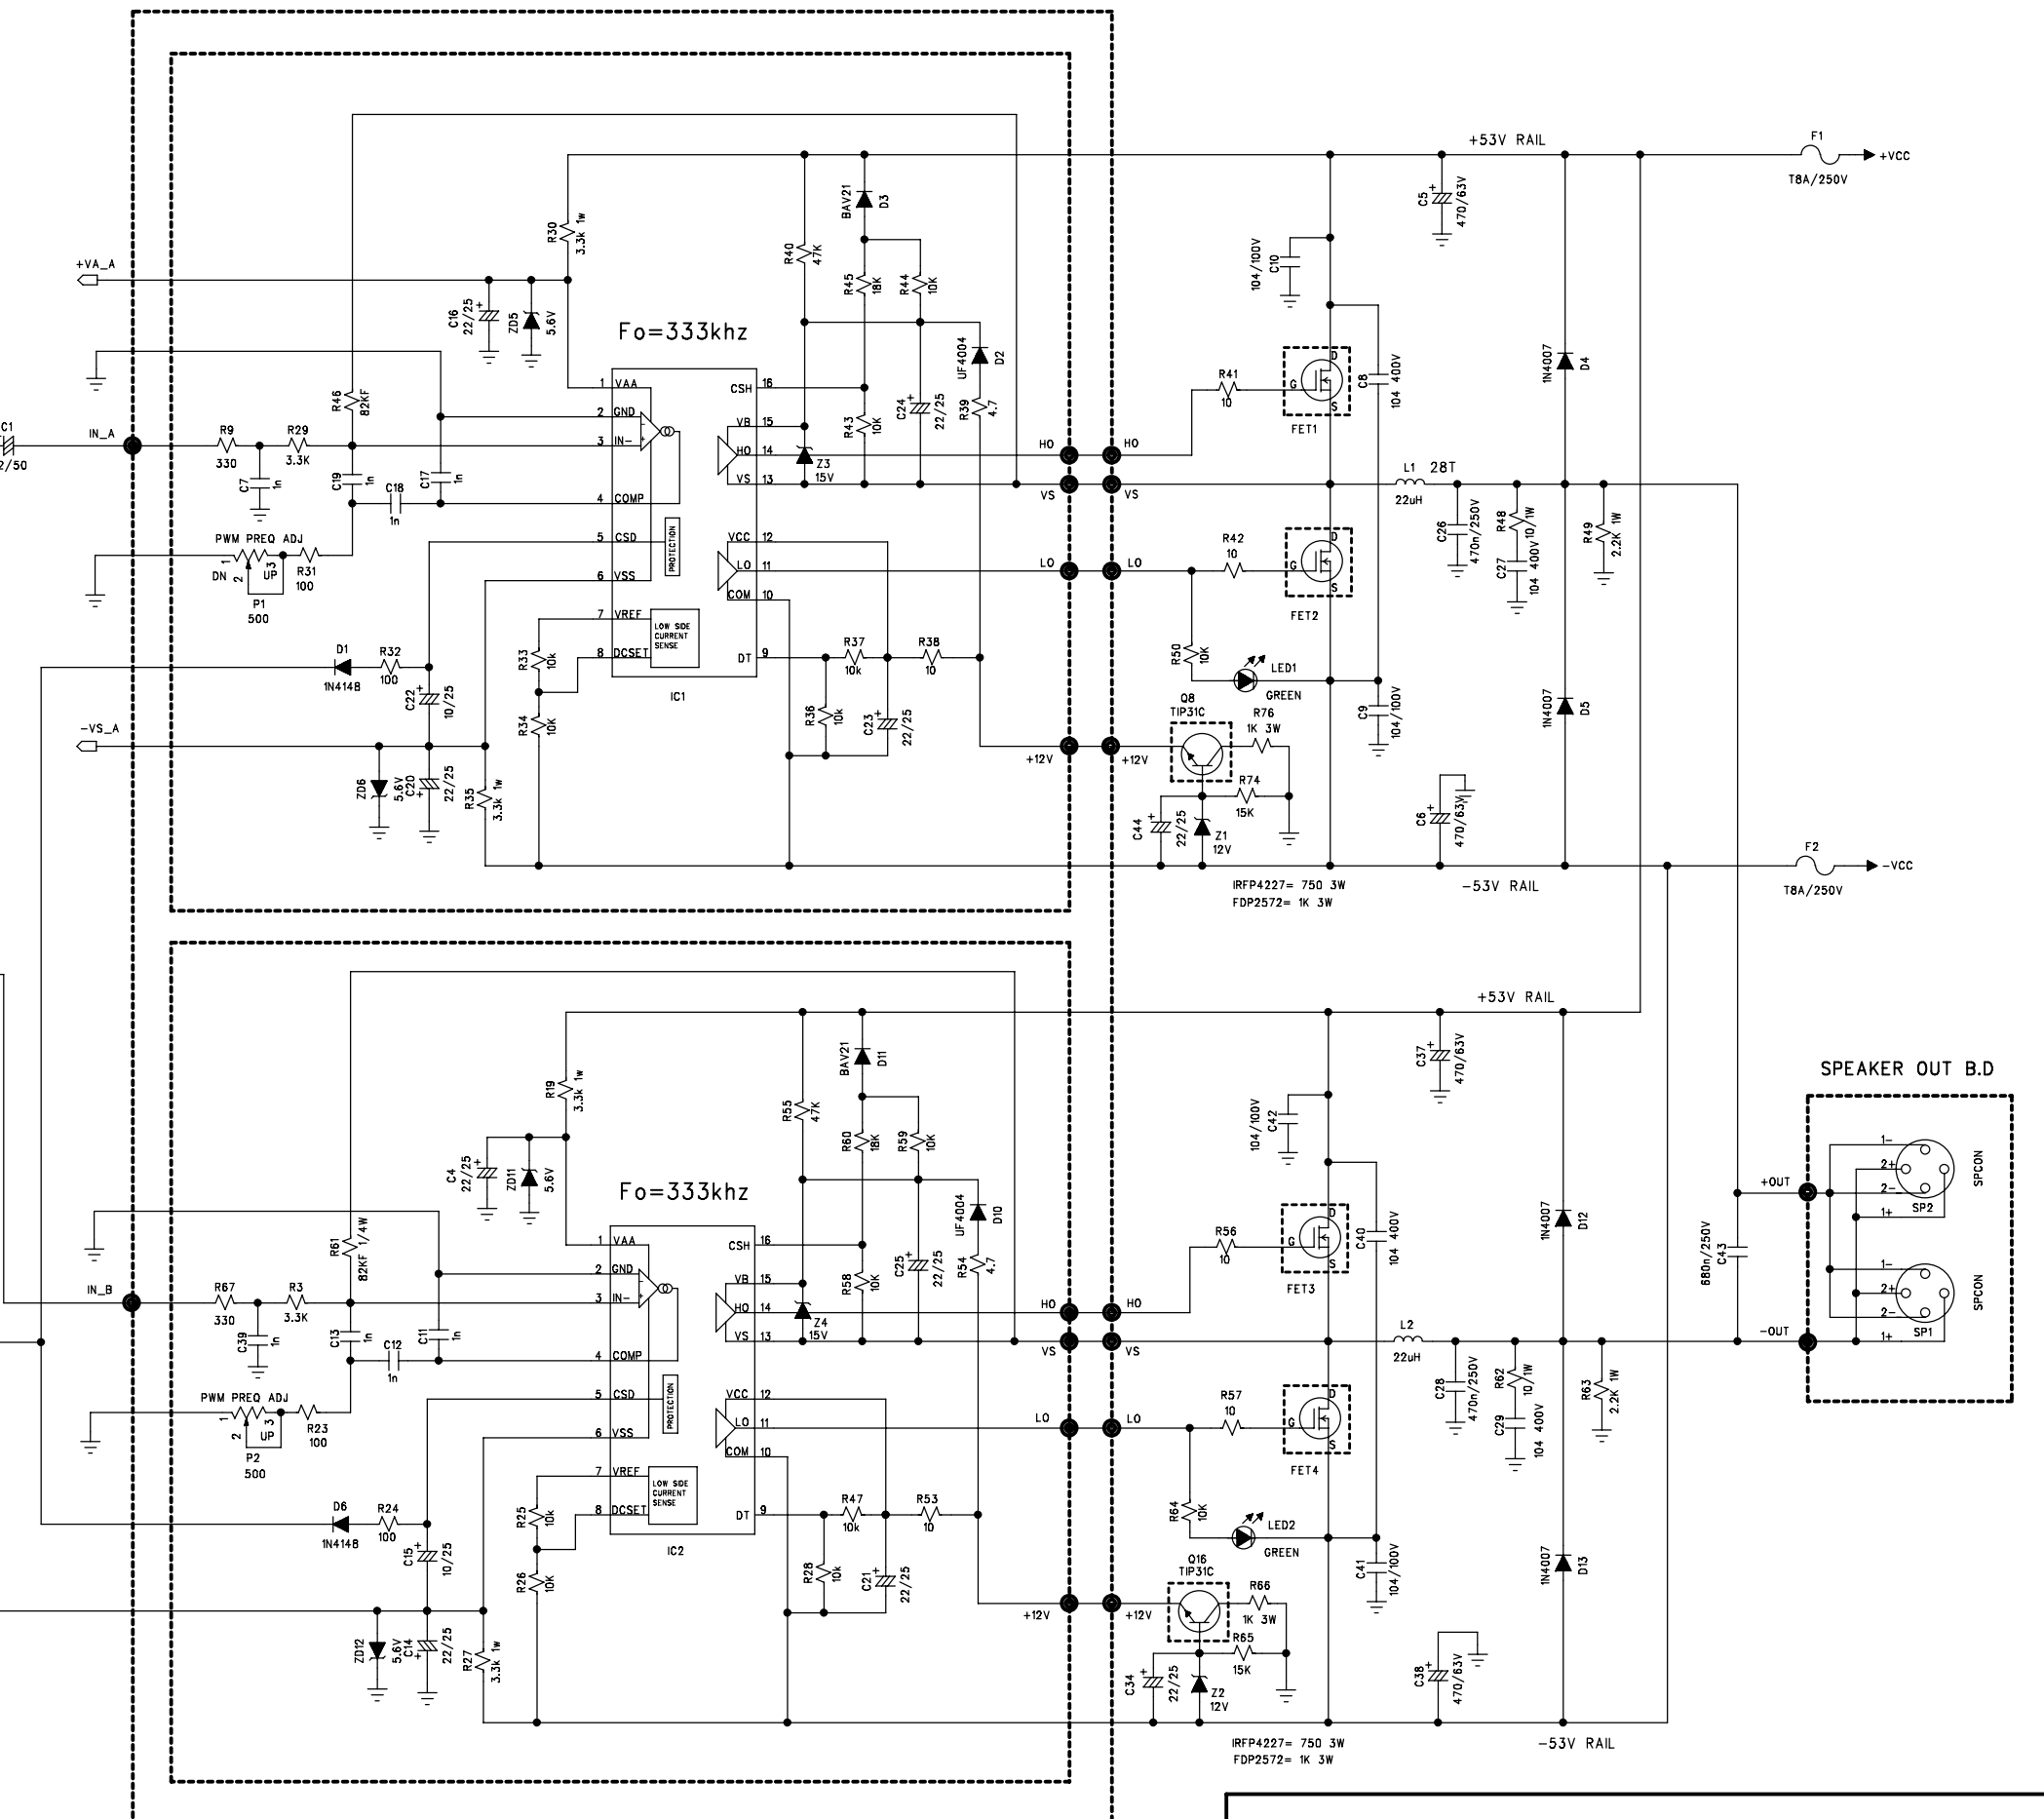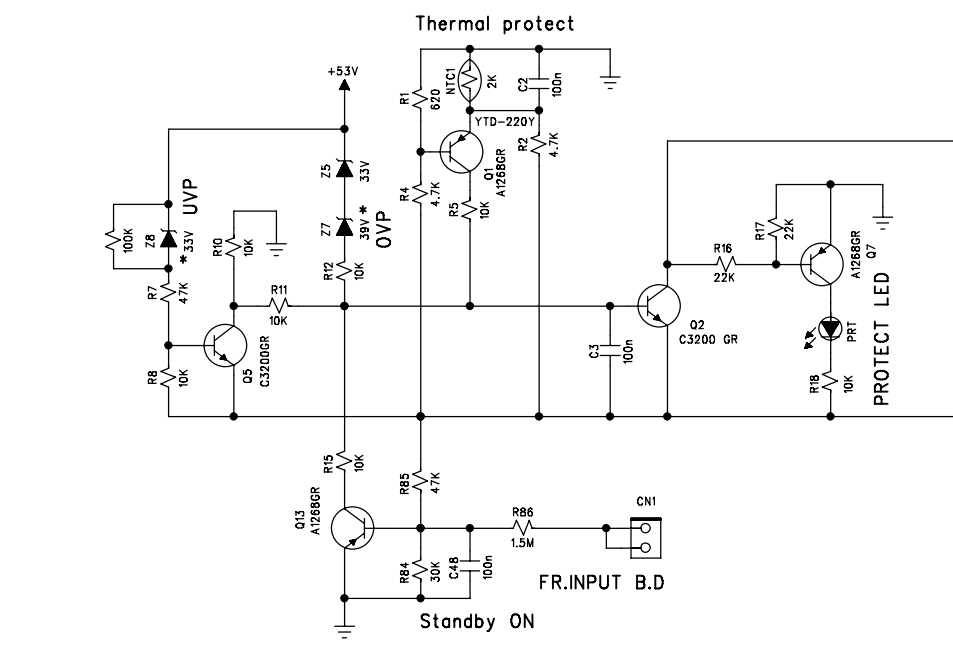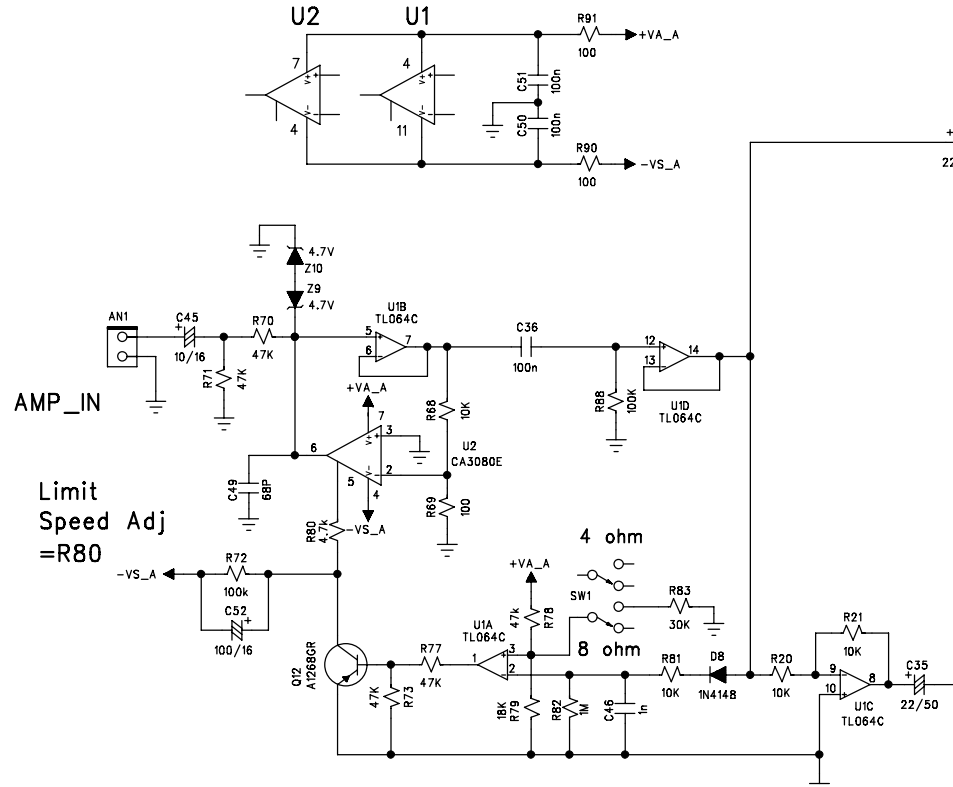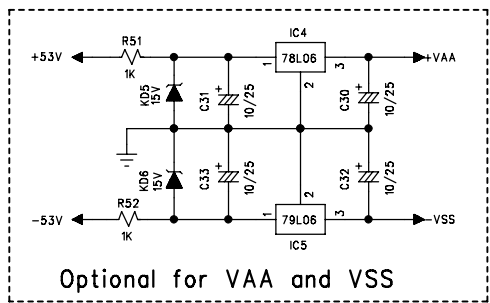

DRAWN: J.S.KIM		DATED: 2009.11.28		COMPANY:	
CHECKED:		DATED:		TITLE: TERROR BASS 500W AMP	
QUALITY CONTROL:		DATED:		CODE:	SIZE:
RELEASED:		DATED:		DRAWING NO:	REV:
		SCALE:		SHEET: OF	