



© NEMKO/CB VERSIONS

- NOTES:
1. ALL COUPLING CAPACITORS MPC TYPE
 2. ALL POWER SUPPLY FILTER CAPS 105C TYPE
 3. WIRE TYPE FOR B+ AND FILAMENTS 105C, TEFLON PREFERRED
 4. ALL TRIODES 12AX7A TYPE
 5. ALL POWER TUBES SHOULD BE REPLACED IN TESTED PAIRS
 6. OBSERVE DIFFERENT GROUND POTENTIALS
 7. DISCHARGE ALL POWER SUPPLY POINTS BEFORE SERVICING
 8. ALL MEASUREMENTS TAKEN AT NOMINAL MAINS VOLTAGE
 9. ALL MEASUREMENTS \pm 20%
 10. TEST SIGNAL 1kHz, 25 mVAC AT PREAMP INPUT
 11. ADJUST PREAMP FOR 2 VOLTS AC AT TP31/21
 12. SET PRESENCE CONTROL AT 1
 13. TP41 BIAS ADJUST: -37VDC EL-34, -47 6L6GC, -52 6X50A
 14. NEVER USE CHINESE OUTPUT TUBES. MECHANICALLY UNSTABLE

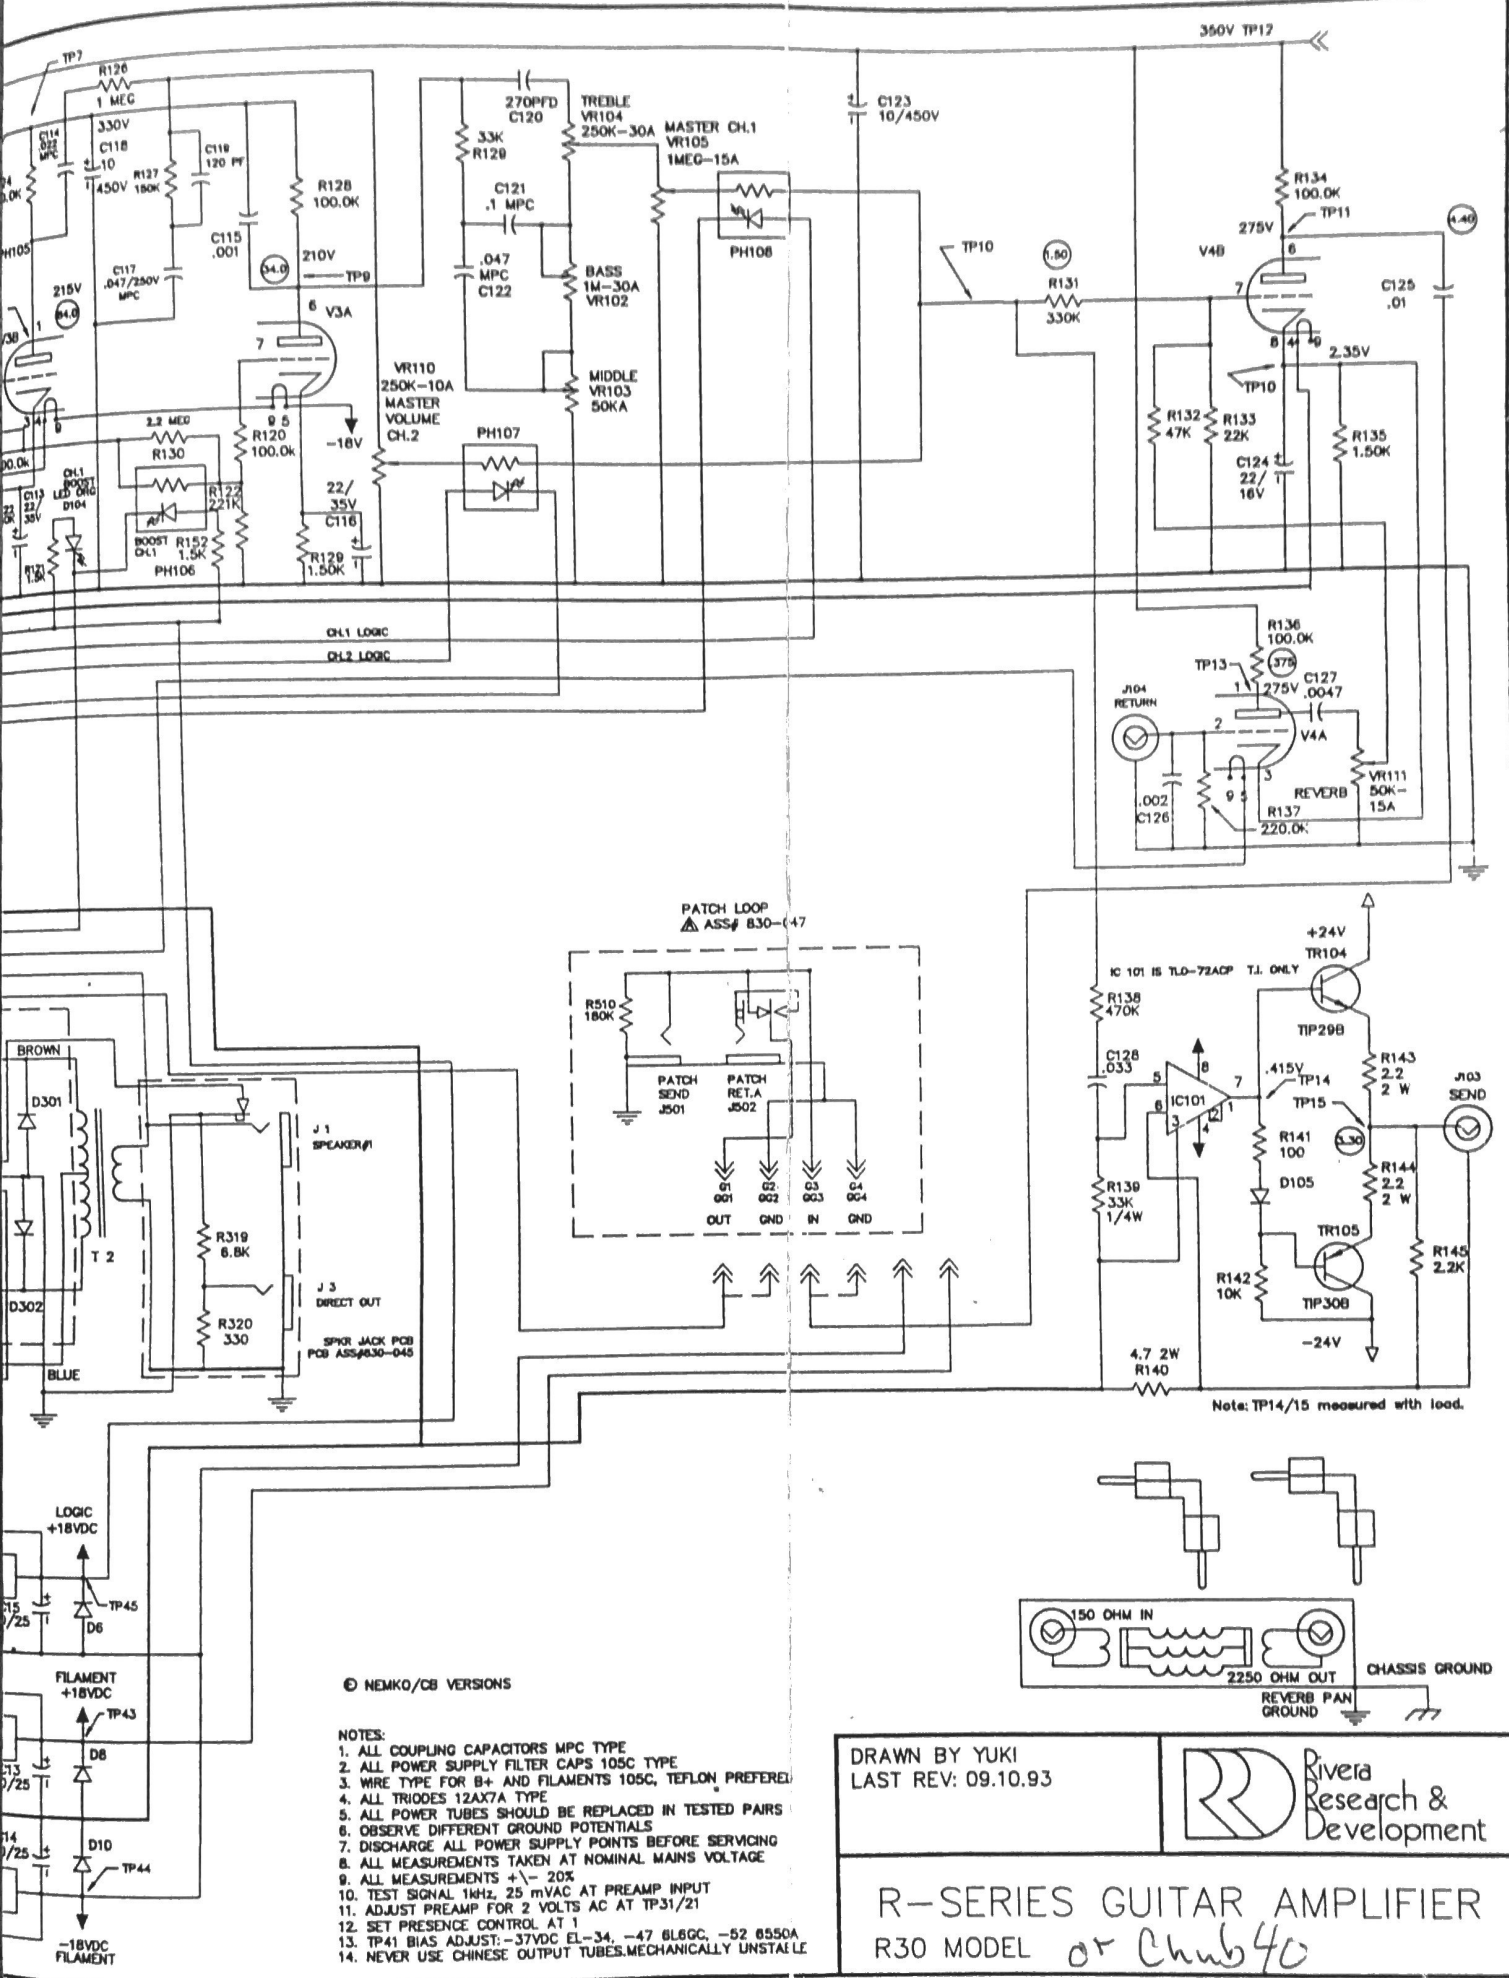

© NEMKO/CB VERSIONS

- NOTES:
1. ALL COUPLING CAPACITORS MPC TYPE
 2. ALL POWER SUPPLY FILTER CAPS 105C TYPE
 3. WIRE TYPE FOR B+ AND FILAMENTS 105C, TEFLON PREFERRED
 4. ALL TRIODES 12AX7A TYPE
 5. ALL POWER TUBES SHOULD BE REPLACED IN TESTED PAIRS
 6. OBSERVE DIFFERENT POWER SUPPLY POINTS BEFORE SERVICING
 7. DISCHARGE ALL POWER SUPPLY POINTS BEFORE MAINS VOLTAGE
 8. ALL MEASUREMENTS TAKEN AT NOMINAL MAINS VOLTAGE
 9. ALL MEASUREMENTS $\pm 1\%$ - 20%
 10. TEST SIGNAL 1KHZ. 25 mVAC AT PREAMP INPUT
 11. ADJUST PREAMP FOR 2 VOLTS AC AT TP31/21
 12. SET PRESENCE CONTROL AT 1
 13. TP41 BIAS ADJUST: -37VDC EL-34, -47 6L6GC, -52 6550A
 14. NEVER USE CHINESE OUTPUT TUBES. MECHANICALLY UNSTABLE

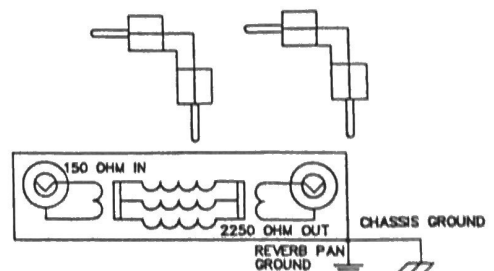

DRAWN BY YUKI
LAST REV: 09.10.93



R-SERIES GUITAR AMPLIFIER
R30 MODEL or Chub40

Note: TP14/15 measured with load.